





Electrolux

Group
Bitola


Ovo je crtez e sopstvenost na Electrolux-Bitola. Bez negovo pismeno odobruvanje isti nesmee da se prepisiva , umnozuva niti kopira bez soglasnost od Electroluks vo sprotivno se snosat posledici vo smislana clenovite 163 i 164 od kivicniot zakon R.M. (povređa na avtorsko pravo)

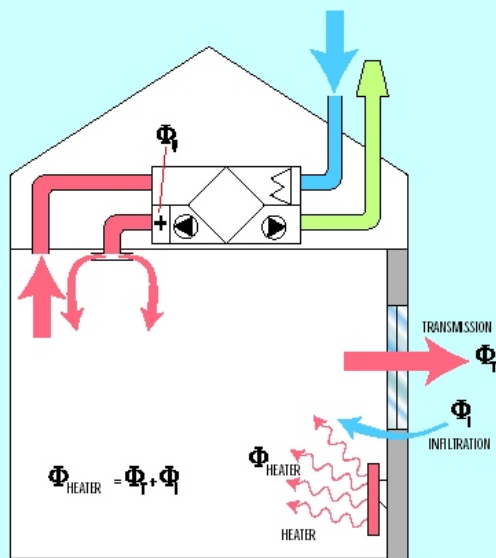


HEAT LOSS DUE TO BALANCED VENTILATION

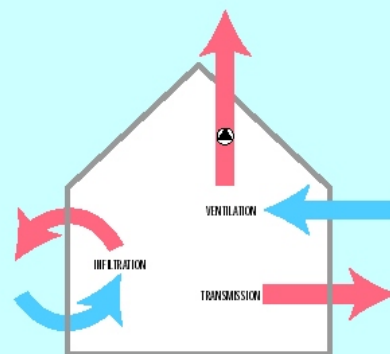


HEAT LOSS IN A BUILDING

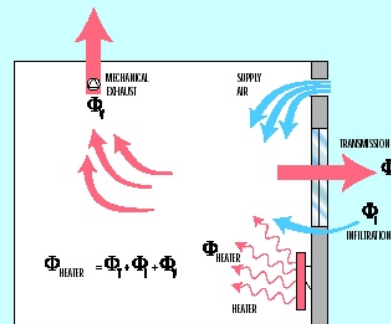


HEAT LOSS DUE TO MECHANICAL EXHAUST VENTILATION

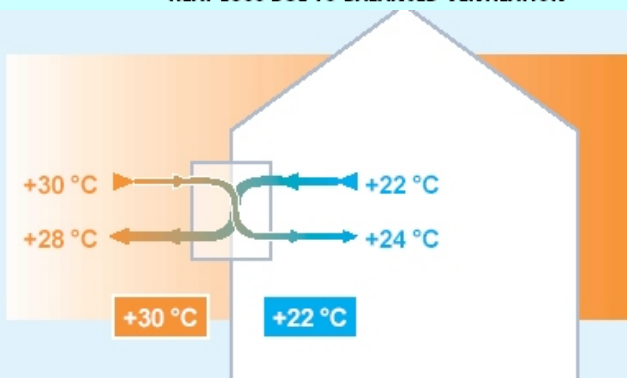

HRV unit in summer

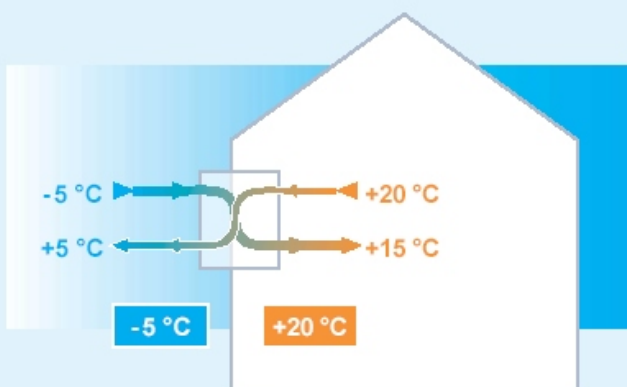

HRV unit in winter




Adresa: ул. Браќа Минѓови бр.18, Ситара Царшија Битола
 Адреса; ул. Ајосџол Гусларов 1-а Г.Т.Ц.Бунјаковец Скопје
 Тел/Факс: 047/203-900; 203-330; 070/237-108
 Тел/Факс: 02/329 8 130; 070/237 198
 www.electroluks.com.mk ,email- elek-palenzo@mt.net.mk







ЕЛЕКТРОЛУКС

Ovaj crtež e sopstvenost na ElectroLux-Bifolia.Bez negovo pismeno odobruvanje isitot nesmee da se prepisiva „umnozuvata niti kopira bez soglasnost od ElectroLuks vo sprotno se snosat posledici vo smislana clenovite 163 i 164 od krivicniot zakon R.M. (sovrada na avtorsko pravo)

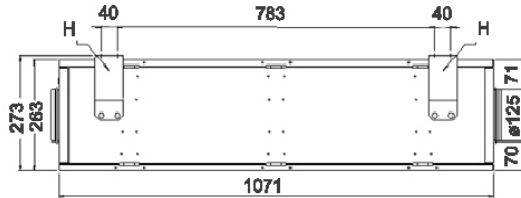

- A Filter, fresh air-/outside air EU7
- B Rotating heat recovery unit
- C Supply air fan
- D Reheater battery, electrical
- heating element, 500W
- E Filter, extract EU3
- F Extract air fan
- G Control circuit board and rotor motor
for heat exchanger
- H Anti-vibration ceiling mounting bracket

- Duct connections, $\phi 125$ mm
- 1 Fresh air/outside air
- 2 Exhaust air
- 3 Supply air
- 4 Extract air
- 5 Cooker hood

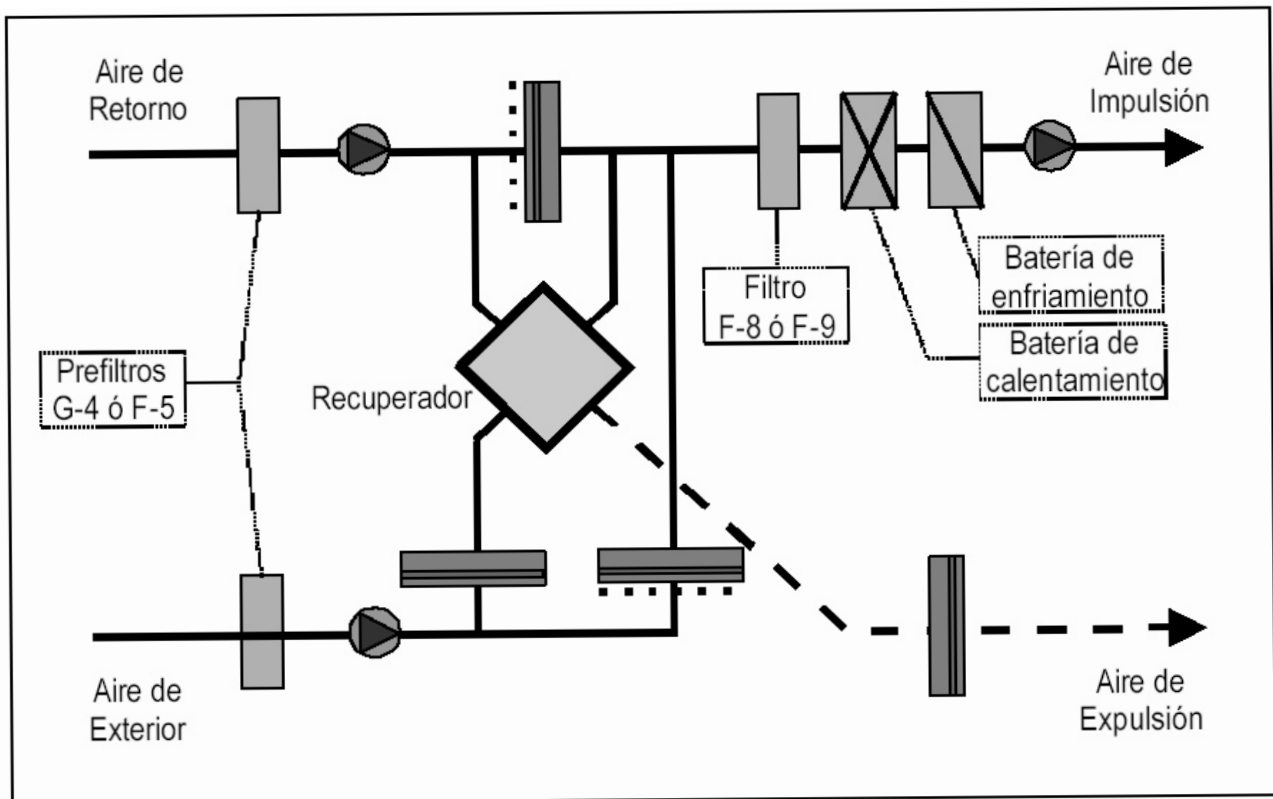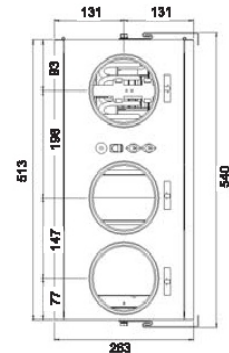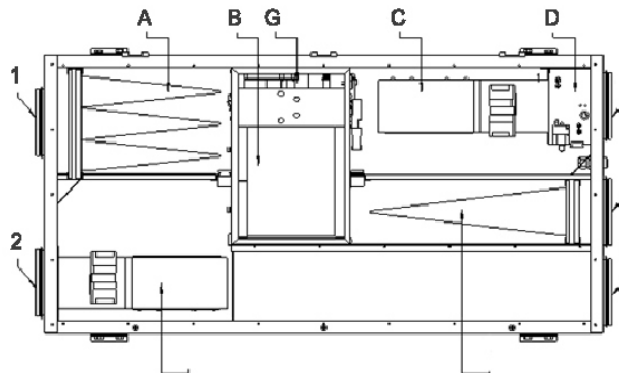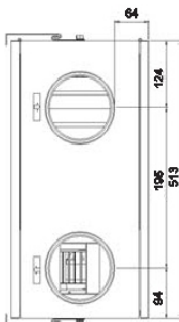

Адреса: ул. Браќа Минџови бр.18, Биџола
 Скопје: ул. Ајосџол Гусларов 1-а
 Тел/Факс: 047/203-900; 203-330; 070/237-124; 070/237-108
 www.elektroluks.com.mk - elek-palenzo@mt.net.mk

1059